



**Cable ID: P8-071-4 2/3#**


**Test Limit: ISO Patch Cord Cat6A 1.0m**  
Limits Version: V7.7  
Date / Time: 02/02/2023 08:50:13 AM  
**Headroom 2.1 dB (NEXT 3,6-4,5)**  
Cable Type: Cat 6A U/UTP  
NVP: 68.2%

Main: Versiv  
S/N: 1707014  
Software Version: V6.8 Build 6  
Calibration Date: 02/23/2022  
Adapter: DSX-8000 (DSX-PC6A)  
S/N: 3661383


**Test Summary: PASS**

Remote: Versiv  
S/N: 1707027  
Software Version: V6.8 Build 6  
Calibration Date: 02/23/2022  
Adapter: DSX-8000R (DSX-PC6A)  
S/N: 3661361

Length (ft)	[Pair 1,2]	4
Prop. Delay (ns)	[Pair 3,6]	7
Delay Skew (ns)	[Pair 3,6]	1
Resistance (ohms)	[Pair 3,6]	0.18







Wire Map (T568B)



Worst Case Margin Worst Case Value

PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
<b>NEXT (dB)</b>	2.1	2.5	3.1	2.6
Freq. (MHz)	291.0	463.0	462.0	465.0
Limit (dB)	37.4	31.9	31.9	31.8

PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	3,6	3,6
<b>RL (dB)</b>	0.2*	1.2	1.6	1.8
Freq. (MHz)	309.0	312.0	465.0	470.0
Limit (dB)	12.6	12.6	10.0	9.9

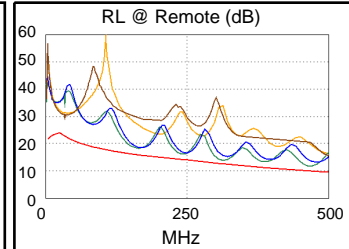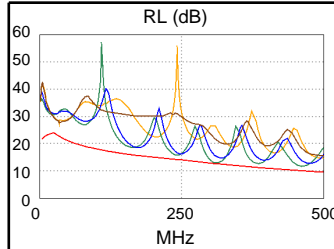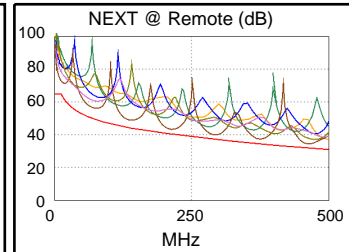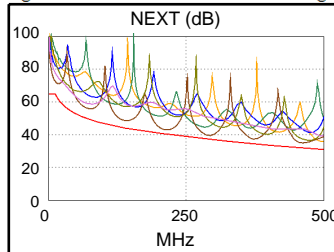

\* Measurement is within the accuracy limits of the instrument.