

Cable ID: P8-069-15 TIA TEST-2


Test Limit: TIA 568.2-D Patch Cord Cat6A 1.0m
Limits Version: V7.6
Date / Time: 04/25/2022 03:16:46 PM
Headroom 1.7 dB (NEXT 3,6-4,5)
Cable Type: Cat 6A F/UTP
NVP: 74.0%

Main: Versiv
S/N: 1707014
Software Version: V6.7 Build 1
Calibration Date: 02/23/2022
Adapter: DSX-8000 (DSX-PC6A)
S/N: 3661383


Test Summary: PASS

Remote: Versiv
S/N: 1707027
Software Version: V6.7 Build 1
Calibration Date: 02/23/2022
Adapter: DSX-8000R (DSX-PC6A)
S/N: 3661361

Length (ft)	[Pair 1,2]	4
Prop. Delay (ns)	[Pair 4,5]	6
Delay Skew (ns)	[Pair 3,6]	1
Resistance (ohms)	[Pair 3,6]	0.21







Wire Map (T568B)



Worst Case Margin Worst Case Value

PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	1.8	1.7	3.7	4.1
Freq. (MHz)	268.0	264.0	500.0	500.0
Limit (dB)	37.2	37.4	29.6	29.6

PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	3,6	3,6
RL (dB)	0.4*	0.9	1.2	2.5
Freq. (MHz)	307.0	205.5	500.0	500.0
Limit (dB)	12.7	14.9	9.5	9.5

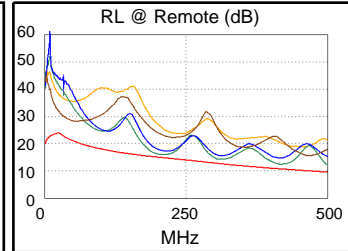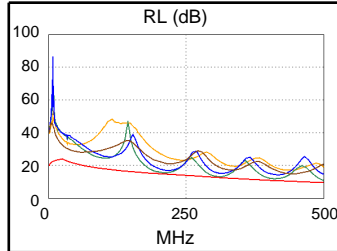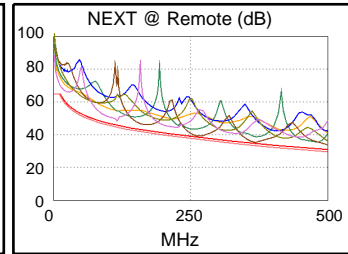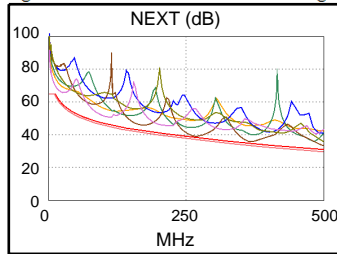

* Measurement is within the accuracy limits of the instrument.