



# Cable ID: PMC-P8-M02-001


## Test Summary: PASS

Date / Time: 09/25/2006 09:05:30am  
**Headroom: 3.0 dB (NEXT 36-45)**  
**Test Limit: TIA C6 1 m Patch Cord**  
 Cable Type: UTP 100 Ohm Cat 6  
 Fault Anomaly Threshold: 15%


Operator: Your Name  
 Software Version: 1.921  
 Limits Version: 5.16c  
 NVP: 69.1%  
 Shield Test: N/A

Model: DSP-4300  
 Main S/N: 8467008  
 Remote S/N: 8467008  
 Main Adapter: LIA 006  
 Remote Adapter: LIA 006


Wire Map	1 2 3 4 5 6 7 8 S
<b>PASS</b>	
	1 2 3 4 5 6 7 8



Length (ft)	[Pair 78]	5
Prop. Delay (ns)	[Pair 12]	8
Delay Skew (ns)	[Pair 12]	1
Resistance (ohms)		N/A

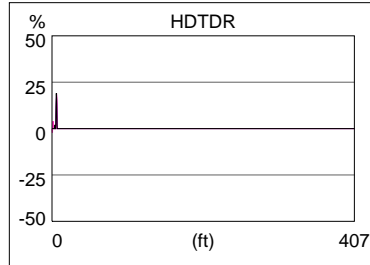

	Worst Case Margin		Worst Case Value	
	MAIN	SR	MAIN	SR
<b>PASS</b>				
Worst Pair	36-45		12-45	
<b>NEXT (dB)</b>	3.0		3.2	
Freq. (MHz)	203.5		249.5	
Limit (dB)	41.0		39.2	

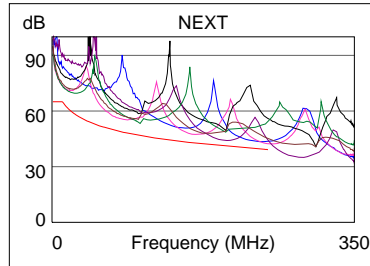

	MAIN	SR	MAIN	SR
	<b>PASS</b>			
Worst Pair	45		45	
<b>RL (dB)</b>	4.8		4.8	
Freq. (MHz)	228.0		228.0	
Limit (dB)	14.4		14.4	

